

30

LINE POST	
CAT. NO. VI 57-2	
"F" NECK	
34.5 kV	ANSI 57-2

ENG. MGR.  
 2 ENG.  
 PURCH.  
 MKTG.  
 PLT. MGR.  
 COST  
 PROD.  
 INSP.  
 GLAZE  
 BUSHING  
 MAKING  
 SHIP.  
 ASSEM.  
 MODEL  
 MACH.  
 45  
 TOOLING  
 CER. LAB.  
 EL. LAB.  
 Q. A.

DIMENSIONS

LEAKAGE DISTANCE	IN	22
DRY ARCING DISTANCE	IN	9 1/2

MECHANICAL VALUES

CANTILEVER STRENGTH	LB	2,800
---------------------	----	-------

ELECTRICAL VALUES


60 HERTZ FLASHOVER - DRY	kV	110
60 HERTZ FLASHOVER - WET	kV	85
IMPULSE FLASHOVER - POS.	kV	160
IMPULSE FLASHOVER - NEG.	kV	205

RADIO INFLUENCE VOLTAGE DATA

60 HERTZ TEST VOLTAGE	kV	22
MAXIMUM RIV @ 1000 kHz	$\mu$ V	100

PACKING INFORMATION

NET WEIGHT PER 100	LB	1550
GROSS WEIGHT PER 100	LB	1600
NO. IN STANDARD PACKAGE		3

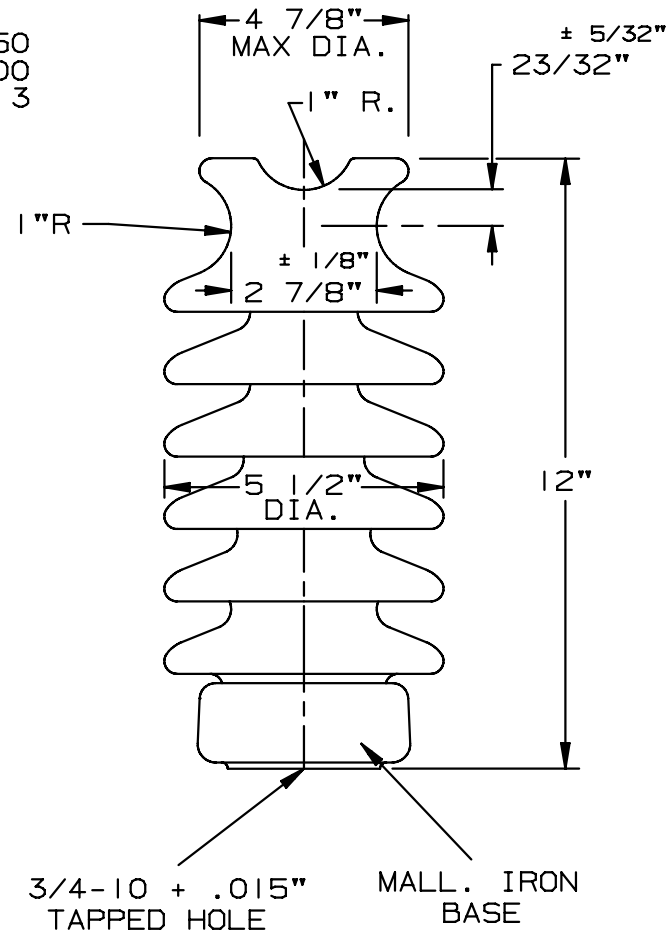

THIS DRAWING IS THE PROPERTY OF VICTOR INSULATORS, INC. AND CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION WHICH MUST NOT BE DUPLICATED, USED, OR DISCLOSED OTHER THAN AS EXPRESSLY AUTHORIZED BY VICTOR INSULATORS, INC.

APPROVED  
 By A. E. Schwalm at 9:14 am, Aug 25, 2009

08-21-09	TM		A
8-26-03	TM	AS	

	INSULATORS VICTOR INSULATORS, INC. 280 MAPLE AVENUE VICTOR, NEW YORK 14564 TELEPHONE: (585)924-2127	VI 57-2
--	---	---------