

STATION POST

CAT. NO. 1505

34.5 kV

200 kV BIL

30

- 1 ENG. MGR
- 2 ENG
- PURCH.
- 1 MKTG.
- PLT. MGR.
- COST
- PROD.
- INSP
- GLAZE
- BUSHING
- MAKING
- SHIP
- ASSEM
- MODEL
- MACH.
- 45
- TOOLING
- CER LAB
- EL LAB
- Q. A.
- 1 EL. MEDIA

DIMENSIONS

LEAKAGE DISTANCE IN 37

MECHANICAL VALUES

CANTILEVER STRENGTH, UPRIGHT	LB	4,000
CANTILEVER STRENGTH, UNDERHUNG	LB	4,000
TENSILE STRENGTH	LB	28,000
TORSION STRENGTH	IN-LB	40,000
COMPRESSION STRENGTH	LB	60,000

ELECTRICAL VALUES


IMPULSE FLASHOVER-POS.	KV	225
IMPULSE WITHSTAND	KV	200
60 HERTZ WITHSTAND-WET	KV	80

RADIO INFLUENCE VOLTAGE DATA

RIV TEST VOLTAGE TO GROUND	kV	22
MAXIMUM RIV @ 1000 KHZ	µV	100

PACKING INFORMATION

NET WEIGHT, EACH	LB	75
PACKED WEIGHT, EACH	LB	85
NO. IN STD. PACKAGE		1

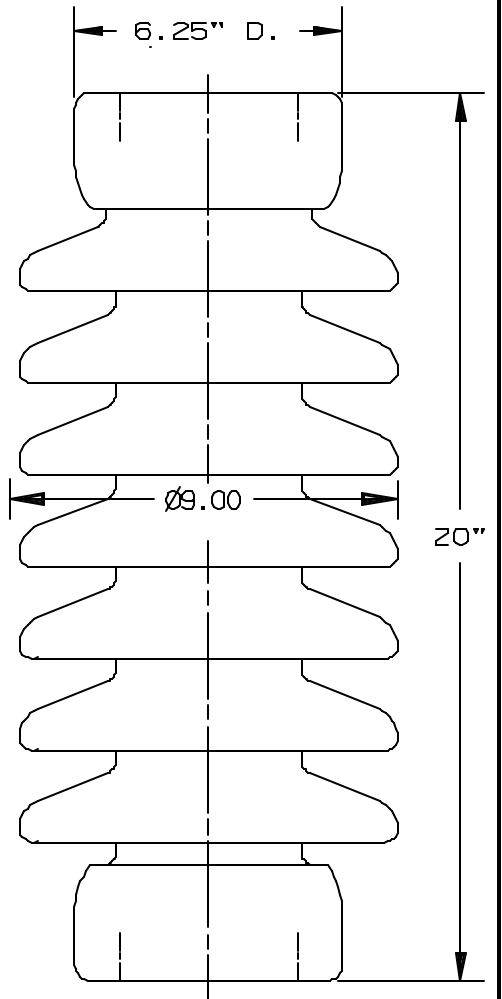

4 HOLES EACH END
5/8-11+.015" ON 5" B.C.

THIS DRAWING IS THE PROPERTY OF VICTOR INSULATORS, INC. AND CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION WHICH MUST NOT BE DUPLICATED, USED, OR DISCLOSED OTHER THAN AS EXPRESSLY AUTHORIZED BY VICTOR INSULATORS, INC.

03-11-02

TM PP AS

12-11-97

FD PP AS



Victor Insulators, Inc.

280 MAPLE AVENUE
VICTOR, NEW YORK 14564
TELEPHONE: (716)924-2127

1505