

30

STATION POST	
CAT. NO. 16PT34	
345 kV	1300 kV BIL

- 1 ENG. MGR.
- 2 ENG.
- PURCH.
- 1 MKTG.
- PLT. MGR.
- COST
- PROD.
- INSP.
- GLAZE
- BUSHING
- MAKING
- SHIP.
- ASSEM.
- MODEL
- MACH.
- 45
- TOOLING
- CER. LAB.
- 1 EL. LAB.
- 1 E. MEDIA

DIMENSIONS

LEAKAGE DISTANCE IN 231

MECHANICAL VALUES

CANTILEVER STRENGTH LB 2,050
 TENSILE STRENGTH LB 20,000
 TORSION STRENGTH IN-LB 40,000
 COMPRESSION STRENGTH LB 60,000

ELECTRICAL VALUES

IMPULSE FLASHOVER-POS. kV 1,410
 60 HERTZ WITHSTAND-WET kV 525
 IMPULSE WITHSTAND kV 1,300


RADIO INFLUENCE VOLTAGE DATA

60 HERTZ TEST VOLTAGE kV 220
 MAXIMUM RIV @ 1000 kHz uV 1,000

PACKING INFORMATION

NET WEIGHT , COLUMN LB 446
 PACKED WEIGHT , COLUMN LB 481
 NO. IN STANDARD PACKAGE 1


4 HOLES
 $\frac{3}{4}$ -10 + .015" ON 7" B.C.

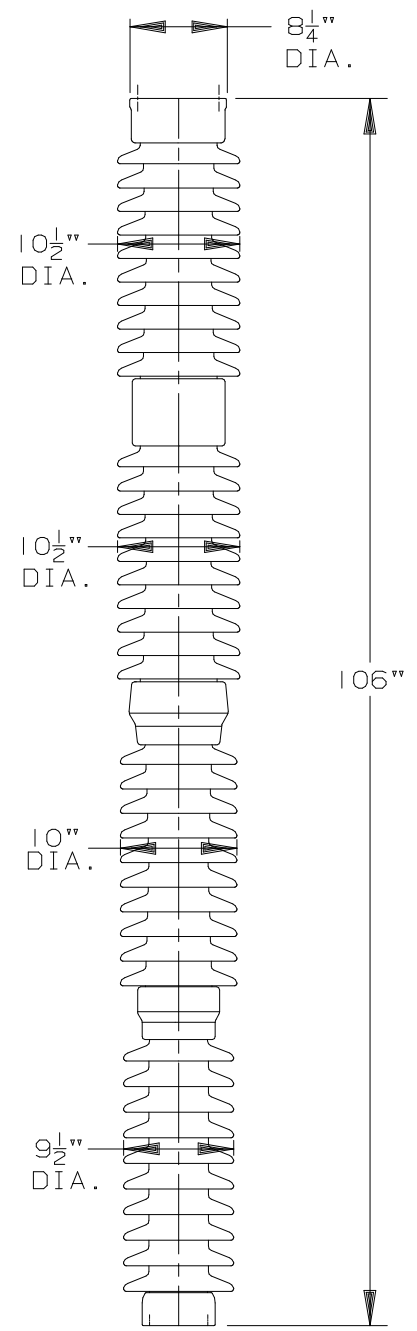

4 HOLES
 $\frac{5}{8}$ -11 + .015" ON 5" B.C.

THIS DRAWING IS THE PROPERTY OF VICTOR INSULATORS, INC. AND CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION WHICH MUST NOT BE DUPLICATED, USED, OR DISCLOSED OTHER THAN AS EXPRESSLY AUTHORIZED BY VICTOR INSULATORS, INC.

7-26-01	TM	PP	AS	C
8-28-00	TM	PP	AS	B
5-05-99	DG			A
03-01-95	TP			



Victor Insulators, Inc.
 280 MAPLE AVENUE
 VICTOR, NEW YORK 14564
 TELEPHONE: (716)924-2127

16PT34