

30

STATION POST	
CAT. NO. 1598	
34.5kV	200kV BIL
TR 10	

1 ENG. MGR
 2 ENG
 PURCH.
 1 MKTG.
 PLT.MGR.
 COST
 PROD.
 INSP
 GLAZE
 BUSHING
 MAKING
 SHIP
 ASSEM
 MODEL
 MACH.
 45
 TOOLING
 CER LAB
 EL LAB
 E. MEDIA

DIMENSIONS

LEAKAGE DISTANCE IN 33

MECHANICAL VALUES

CANTILEVER STRENGTH, UPRIGHT LB 2,000
 CANTILEVER STRENGTH, UNDERHUNG LB 2,000
 TENSION STRENGTH LB 7,000
 BUSHING TORSION STRENGTH IN-LB 10,000
 MAKING COMPRESSION STRENGTH LB 15,000

ELECTRICAL VALUES

IMPULSE FLASHOVER-POS. kV 225
 IMPULSE WITHSTAND KV 200
 60 HERTZ WITHSTAND-WET kV 80


RADIO INFLUENCE VOLTAGE DATA

RIV TEST VOLTAGE TO GROUND KV 22
 MAXIMUM RIV AT 1000 KHZ μV 100

PACKING INFORMATION

NET WEIGHT, EACH LB 34
 PACKED WEIGHT, EACH LB 36
 NO. IN STD. PACKAGE 2

4 HOLES
 $\frac{1}{2}$ "-13 +.015" ON 3" B.C.

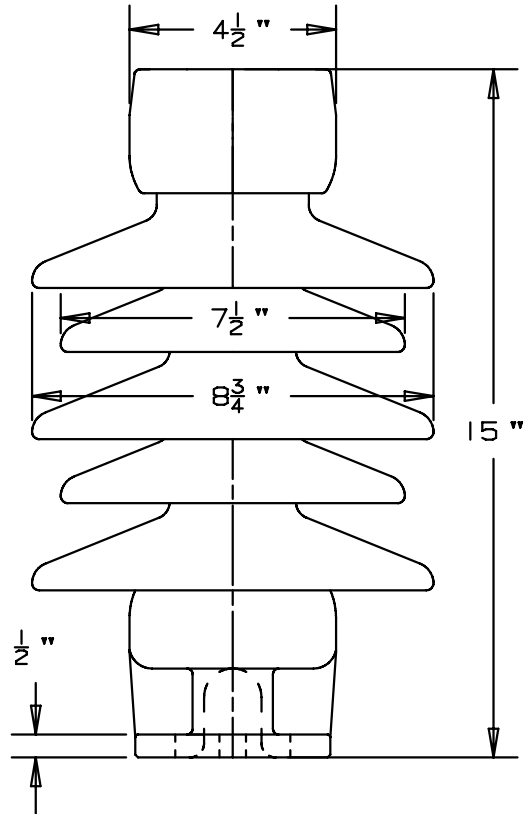

4 SLOTS
 .58" WIDE, .87" DEEP
 ON 3" B.C.

THIS DRAWING IS THE PROPERTY OF VICTOR INSULATORS, INC. AND CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION WHICH MUST NOT BE DUPLICATED, USED, OR DISCLOSED OTHER THAN AS EXPRESSLY AUTHORIZED BY VICTOR INSULATORS, INC.

FILE: 1598

APPROVED
By A. E. Schwalm at 8:19 am, Apr 30, 2009

04-29-09	REV'D BASE	TM		
04-01-03		TM	AS	
04-24-02		TM	PP	AS



Victor Insulators, Inc.
 280 MAPLE AVENUE
 VICTOR, NEW YORK 14564
 TELEPHONE: (585)924-2127

1598