

STATION POST

CAT. NO. 1747

46 kV 250 kV BIL

TR NO. 13 REPLACEMENT

- 1 ENG. MGR
- 2 ENG
- PURCH.
- 1 MKTG.
- PLT.MGR.
- COST
- PRD.
- INSP
- GLAZE
- BUSHING
- MAKING
- SHIP
- ASSEM
- MODEL
- MACH.
- 45
- TOOLING
- CER LAB
- 1 EL LAB
- 1 E.MEDIA

DIMENSIONS:

LEAKAGE DISTANCE IN 50 [1270 mm]

MECHANICAL VALUES:

CANTILEVER STRENGTH LB 2,000 [8.9 kN]
 TENSION STRENGTH LB 8,000 [35.6 kN]
 TORSION STRENGTH IN-LB 12,000 [1.4 kN]
 COMPRESSION STRENGTH LB 15,000 [66.7 kN]

ELECTRICAL VALUES:

IMPULSE FLASHOVER-POSITIVE kV 280
 60 HERTZ WITHSTAND-WET kV 100
 IMPULSE WITHSTAND kV 250


RADIO INFLUENCE VOLTAGE DATA:

60 HERTZ TEST VOLTAGE TO GROUND kV 30
 MAXIMUM R.I.V. @ 1000 kHz μV 200

PACKAGING INFORMATION:

NET WEIGHT, LB 56
 PACKED WEIGHT LB 59
 NO. IN STANDARD PACKAGE 2

4 HOLES
 1/2"-13 +.015 on 3" B.C.

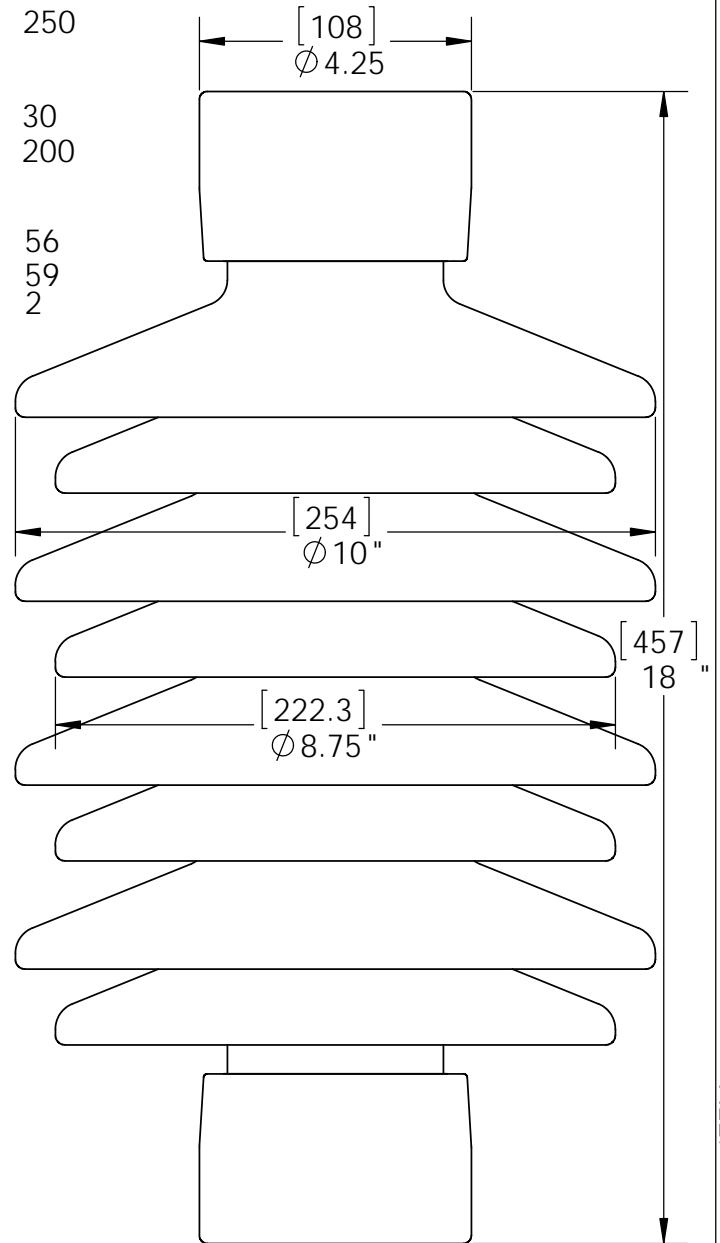

DIMENSIONS IN []
 ARE METRIC ALL
 OTHERS ARE
 STANDARD

THIS DRAWING IS THE PROPERTY OF
 VICTOR INSULATORS, INC. AND CONTAINS
 PROPRIETARY AND CONFIDENTIAL INFORMATION
 WHICH MUST NOT BE DUPLICATED, USED,
 OR DISCLOSED OTHER THAN AS EXPRESSLY
 AUTHORIZED BY VICTOR INSULATORS, INC.

APPROVED
 By A. E. Schwalm at 9:19 am, Apr 08, 2015



Victor Insulators, Inc.

280 Maple Avenue
 Victor, New York 14564
 Telephone: (585)924-2127
 www.victorinsulators.com

1747

04-08-15

TM