

19

STATION POST	
CAT. NO. 1769	
69 kV	350 kV BIL
REPLACES TR 16	
SOLID CORE PORCELAIN	

1 ENG. MGR.
 2 ENG.
 PURCH.
 MKTG.
 PLT. MGR.
 COST
 PROD.
 INSP.
 GLAZE
 BUSHING
 MAKING
 SHIP.
 ASSEM.
 MODEL
 MACH.
 45
 TOOLING
 CER. LAB.
 EL. LAB.
 Q. A.

DIMENSIONS

LEAKAGE DISTANCE IN 72

MECHANICAL VALUES

CANTILEVER STRENGTH, UPRIGHT	LB	1,500
CANTILEVER STRENGTH, UNDERHUNG	LB	1,500
TENSION STRENGTH	LB	16,000
TORSION STRENGTH	IN-LB	15,000
COMPRESSION STRENGTH	LB	25,000

ELECTRICAL VALUES


IMPULSE FLASHOVER-POS.	kV	390
60 HERTZ WITHSTAND-WET	kV	145
IMPULSE WITHSTAND	kV	350

RADIO INFLUENCE VOLTAGE DATA

RIV TEST VOLTAGE TO GRD.	kV	44
MAXIMUM RIV @ 1000 kHz	μV	200

PACKING INFORMATION

NET WEIGHT, EACH	LB	66
PACKED WEIGHT, EACH	LB	93
NO. IN STANDARD PACKAGE		1

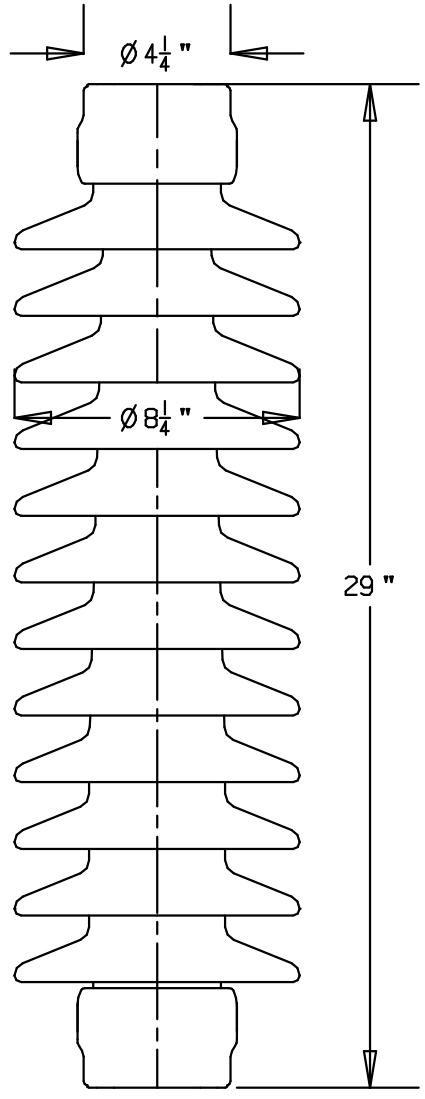


4 HOLES EACH END
 1/2-13 + .015" ON 3" B.C.

THIS DRAWING IS THE PROPERTY OF VICTOR INSULATORS, INC. AND CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION WHICH MUST NOT BE DUPLICATED, USED, OR DISCLOSED OTHER THAN AS EXPRESSLY AUTHORIZED BY VICTOR INSULATORS, INC.

APPROVED
 By A. E. Schwalm at 11:27 am, May 30, 2012

05-29-12	TM			A
05-08-03	TM			

	Victor Insulators, Inc. 280 MAPLE AVENUE VICTOR, NEW YORK 14564 TELEPHONE: (585)924-2127	1769
---	---	------