

30

STATION POST	
CAT. NO. 1770	
69kV	350kV BIL
REPLACES TR 56	

- ENG. MGR
- 2 ENG
- PURCH.
- 1 MKTG.
- PLT. MGR.
- COST
- PROD.
- INSP
- GLAZE
- BUSHING
- MAKING
- SHIP
- ASSEM
- MODEL
- MACH.
- 45
- TOOLING
- CER LAB
- EL LAB
- Q. A.

DIMENSIONS

LEAKAGE DISTANCE IN 72

MECHANICAL VALUES

CANTILEVER STRENGTH, UPRIGHT LB 3,000
 CANTILEVER STRENGTH, UNDERHUNG LB 3,000
 TENSION STRENGTH LB 25,000
 TORSION STRENGTH IN-LB 40,000
 COMPRESSION STRENGTH LB 60,000

ELECTRICAL VALUES


IMPULSE FLASHOVER-POS. KV 390
 IMPULSE WITHSTAND KV 350
 60 HERTZ WITHSTAND-WET kV5 145

RADIO INFLUENCE VOLTAGE DATA

RIV TEST VOLTAGE TO GROUND kV 44
 MAXIMUM RIV @ 1000 KHZ μV 200

PACKING INFORMATION

NET WEIGHT, STACK LB 110
 PACKED WEIGHT, STACKED LB 120
 NO. IN STD. PACKAGE 1

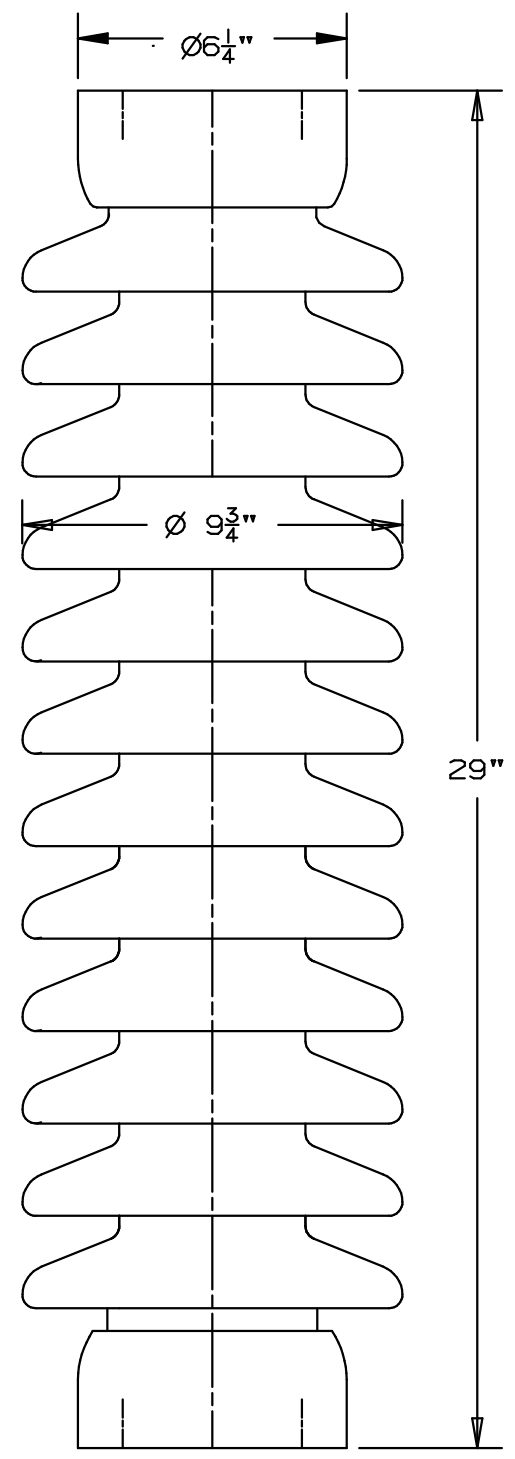

4 HOLES EACH END
 5" -11+.015" ON 5" B.C.

THIS DRAWING IS THE PROPERTY OF VICTOR INSULATORS, INC. AND CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION WHICH MUST NOT BE DUPLICATED, USED, OR DISCLOSED OTHER THAN AS EXPRESSLY AUTHORIZED BY VICTOR INSULATORS, INC.

APPROVED
 By A. E. Schwalm at 7:29 am, Jun 06, 2012

06-06-12		TM	
REDRAWN 5-15-97	MM		



Victor Insulators, Inc.
 280 MAPLE AVENUE
 VICTOR, NEW YORK 14564
 TELEPHONE: (585)924-2127

1770