

S


STATION POST

CAT. NO. 1603 S

345 kV 1300 kV BIL

TR NO. 369

4 HOLES 5/8"-11 +.015
ON 5" B.C.

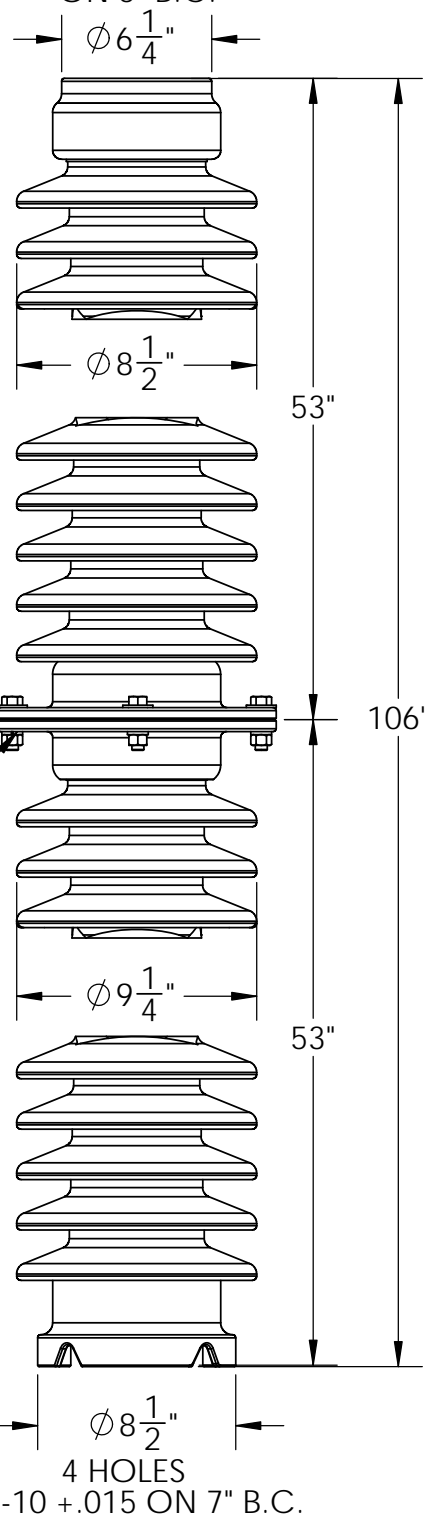

DIMENSIONS:
LEAKAGE DISTANCE IN 231

MECHANICAL VALUES:
CANTILEVER STRENGTH LB 2,050
TENSION STRENGTH LB 20,000
TORSION STRENGTH IN-LB 40,000
COMPRESSION STRENGTH LB 60,000

ELECTRICAL VALUES:
IMPULSE FLASHOVER-POSITIVE kV 1,410
60 HERTZ WITHSTAND-WET kV 525
IMPULSE WITHSTAND kV 1,300

RADIO INFLUENCE VOLTAGE DATA:
60 HERTZ TEST VOLTAGE TO GROUND kV 220
MAXIMUM R.I.V. @ 1000 kHz μ V 1,000

PACKAGING INFORMATION:
NET WEIGHT, LB 412
PACKED WEIGHT LB 430
NO. IN STANDARD PACKAGE 1/2

4 HOLES ϕ .71"
ON 8.85" B.C.

THIS DRAWING IS THE PROPERTY OF VICTOR INSULATORS, INC. AND CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION WHICH MUST NOT BE DUPLICATED, USED, OR DISCLOSED OTHER THAN AS EXPRESSLY AUTHORIZED BY VICTOR INSULATORS, INC.

APPROVED
By A. E. Schwalm at 7:01 am, Feb 25, 2019

02-25-19

TM

08-11-15

TM



Victor Insulators, Inc.

280 Maple Avenue
Victor, New York 14564
Telephone: (585)924-2127
www.victorinsulators.com

1603 S