

30

STATION POST	
CAT. NO. 1724	
230kV	1050 kV BIL
TR NO. 312	
SOLID CORE PORCELAIN	

2 ENG.
MKTG.
I COST
I SHIP.
I ASSEM.
I INSP

DIMENSIONS

LEAKAGE DISTANCE IN 198

MECHANICAL VALUES

CANTILEVER STRENGTH	LB	800
TENSILE STRENGTH	LB	20,000
TORSION STRENGTH	IN-LB	40,000
COMPRESSION STRENGTH	LB	60,000

ELECTRICAL VALUES


60 HERTZ WITHSTAND-WET	kV	455
IMPULSE FLASHOVER-POS.	kV	1210
IMPULSE WITHSTAND	kV	1050

RADIO INFLUENCE VOLTAGE DATA

60 HERTZ TEST VOLTAGE TO GRD.	kV	146
MAXIMUM RIV @ 1000 kHz	μV	500

4 HOLES EACH END
5/8" - 11+.015" ON 5" B.C.

4 HOLES 9/16"
ON 9" B.C.

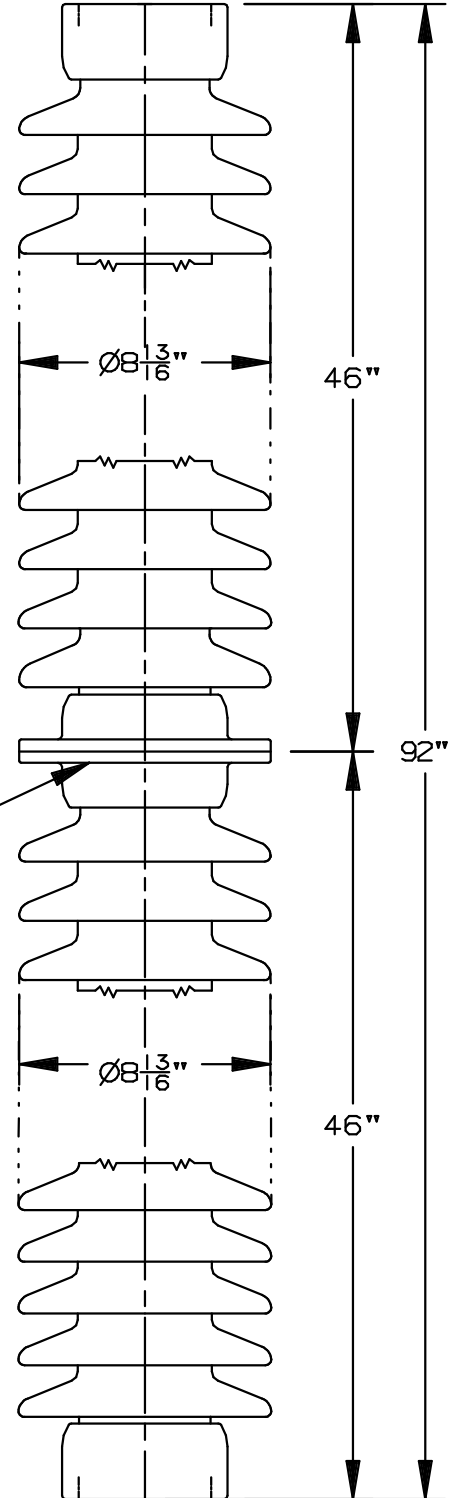

THIS DRAWING IS THE PROPERTY OF VICTOR INSULATORS, INC. AND CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION WHICH MUST NOT BE DUPLICATED, USED, OR DISCLOSED OTHER THAN AS EXPRESSLY AUTHORIZED BY VICTOR INSULATORS, INC.

APPROVED
By A. E. Schwalm at 5:50 pm, May 07, 2014



Victor Insulators, Inc.
280 MAPLE AVENUE
VICTOR, NEW YORK 14564
TELEPHONE: (585)924-2127

1724

05-07-14 TM

FILE: 1724