

COMPOSITE LINE POST

CAT. NO. HP-63DB-1600-4360-XX

- 1 ENG. MGR
- 2 ENG
- PURCH.
- 1 MKTG.
- PLT.MGR.
- COST
- PRD.
- INSP
- GLAZE
- BUSHING
- MAKING
- SHIP
- ASSEM
- MODEL
- MACH.
- 45
- TOOLING
- CER LAB
- 1 EL LAB
- 1 E.MEDIA

DIMENSIONS

LEAKAGE DISTANCE	mm	4,360
DRY ARCING DISTANCE	mm	1,400

MECHANICAL VALUES

SPECIFIED CANTILEVER LOAD(SCL)	kN	12.5
MAX DESIGN CANTILEVER LOAD(MDCL)	kN	6.25

ELECTRICAL VALUES

SYSTEM VOLTAGE	kV	138
IMPULSE FLASHOVER, POSITIVE	kV	675
IMPULSE FLASHOVER, NEGATIVE	kV	785
LOW FREQUENCY FLASHOVER, DRY	kV	440
LOW FREQUENCY FLASHOVER, WET	kV	385


RADIO INFLUENCE VOLTAGE DATA:

R.I.V. TEST VOLTAGE	kV	88
MAXIMUM R.I.V. @ 1 MHZ	µV	500

PACKING INFORMATION

NET WEIGHT	kg	41.7
------------	----	------

THIS DRAWING IS THE PROPERTY OF VICTOR INSULATORS, INC. AND CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION WHICH MUST NOT BE DUPLICATED, USED, OR DISCLOSED OTHER THAN AS EXPRESSLY AUTHORIZED BY VICTOR INSULATORS, INC.

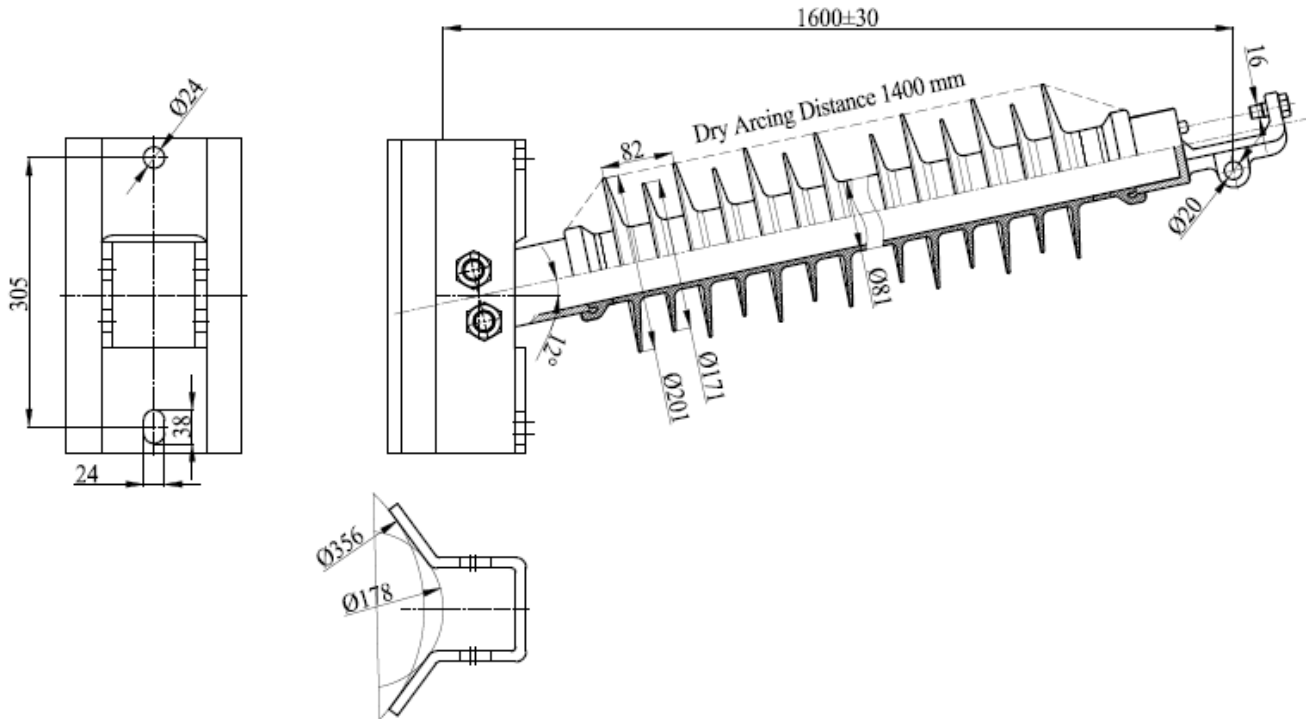

APPROVED
By A. E. Schwalm at 10:04 am, Mar 08, 2023

03-07-23

TM

12-17-20

TM



Victor Insulators, Inc.

280 Maple Avenue
Victor, New York 14564
Telephone: (585)924-2127
www.victorinsulators.com

HP-63DB-
1600-4360-
XX