


COMPOSITE LINE POST

CAT. NO. HP-68DB-1457-4300-XX

- 1 ENG. MGR
- 2 ENG
- PURCH.
- 1 MKTG.
- PLT.MGR.
- COST
- PRD.
- INSP
- GLAZE
- BUSHING
- MAKING
- SHIP
- ASSEM
- MODEL
- MACH.
- 45
- TOOLING
- CER LAB
- 1 EL LAB
- 1 E.MEDIA

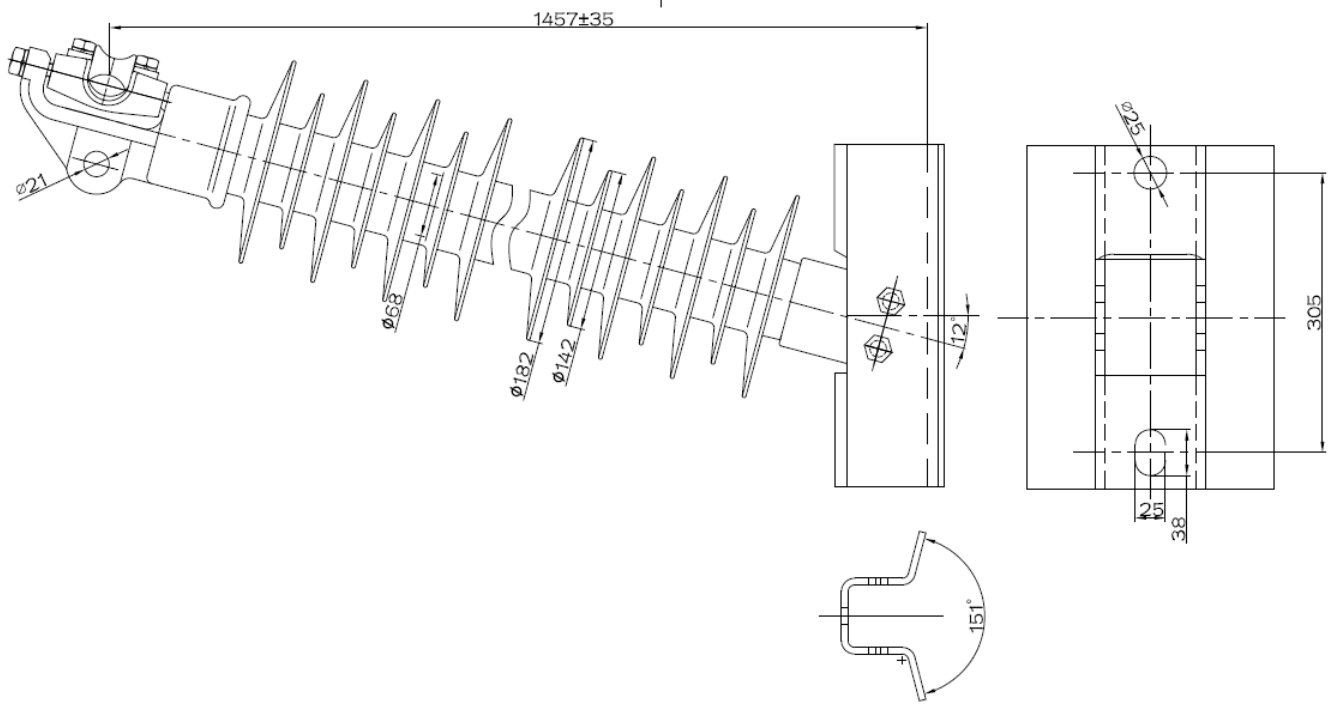

TECHNICAL SPECIFICATIONS:

RATED VOLTAGE	kV	161
IMPULSE FLASHOVER, POSITIVE	kV	750
IMPULSE FLASHOVER, NEGATIVE	kV	800
60 HERTZ FLASHOVER, WET	kV	400
60 HERTZ FLASHOVER, DRY	kV	450
LEAKAGE DISTANCE	mm	4,300
DRY ARCING DISTANCE	mm	1,080
SPECIFIED CANTILEVER LOAD (SCL)	kN	10

THIS DRAWING IS THE PROPERTY OF VICTOR INSULATORS, INC. AND CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION WHICH MUST NOT BE DUPLICATED, USED, OR DISCLOSED OTHER THAN AS EXPRESSLY AUTHORIZED BY VICTOR INSULATORS, INC.

APPROVED
By A. E. Schwalm at 1:46 pm, Oct 25, 2019



Victor Insulators, Inc.
 280 Maple Avenue
 Victor, New York 14564
 Telephone: (585)924-2127
 www.victorinsulators.com

HP-68DB-
1457-4300-
XX

06-19-19

TM