


COMPOSITE INSULATOR

CAT. NO. T223-YB-3675-11050-LG

- 1 ENG. MGR
- 2 ENG
- PURCH.
- 1 MKTG.
- PLT.MGR.
- COST
- PRD.
- INSP
- GLAZE
- BUSHING
- MAKING
- SHIP
- ASSEM
- MODEL
- MACH.
- 45
- TOOLING
- CER LAB
- 1 EL LAB
- 1 E.MEDIA

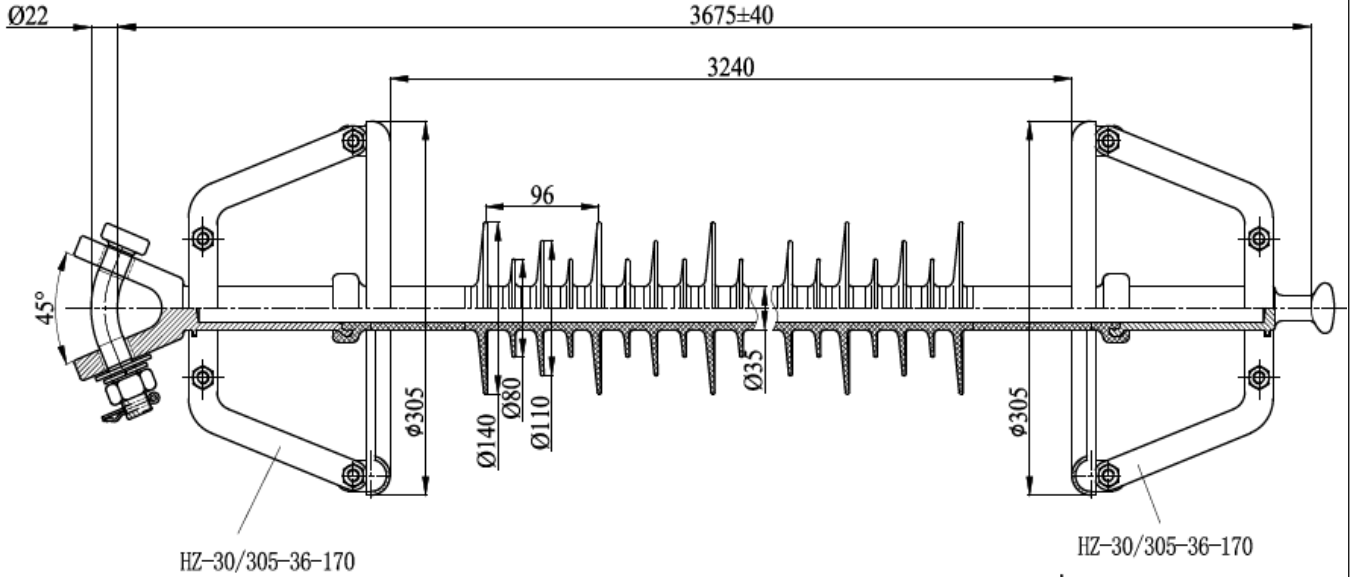

TECHNICAL SPECIFICATIONS:

SYSTEM VOLTAGE	kV	345
LEAKAGE DISTANCE	mm	11,050
DRY ARC DISTANCE	mm	3,240
60 HERTZ FLASHOVER, DRY	kV	1,115
60 HERTZ FLASHOVER, WET	kV	1,000
IMPULSE FLASHOVER, POSITIVE	kV	1,900
IMPULSE FLASHOVER, NEGATIVE	kV	2,005
SPECIFIED MECHANICAL LOAD(SML)	kN	223
ROUTING TEST LOAD(RTL)	kN	111.5
WEIGHT	kg	17.7

THIS DRAWING IS THE PROPERTY OF VICTOR INSULATORS, INC. AND CONTAINS PROPRIETARY AND CONFIDENTIAL INFORMATION WHICH MUST NOT BE DUPLICATED, USED, OR DISCLOSED OTHER THAN AS EXPRESSLY AUTHORIZED BY VICTOR INSULATORS, INC.

APPROVED
By A. E. Schwalm at 9:06 am, Jul 21, 2020



Victor Insulators, Inc.
280 Maple Avenue
Victor, New York 14564
Telephone: (585)924-2127
www.victorinsulators.com

T223-YB-
3675-11050-
LG

07-21-20

TM